

Duct Smoke Detector for Special Applications



Models Available

Smoke Detectors

2151

Base

B114LP

B114LPBT

Accessory

RTC100

2151 with B114LP and RTC100



Product Overview

Low-profile smoke detector design

Low standby current

Two LEDs “blink” in standby

Detector head plugs easily into base

Built-in test switch

Built-in tamper-resistant feature

Field sensitivity metering of detector to meet the requirements of NFPA 72

120VAC and 24VAC/DC bases with built-in shorting spring

Designed for mounting on standard electrical box

SEMS screws for easy wiring and positive wire retention

Removable cover and insect screen for field cleaning

The System Sensor 2151 low-profile photoelectronic smoke detector is UL listed to UL 268A specifically for use in no-flow/low-flow air-handling systems. It's designed for installations where a standard Venturi principle duct smoke detector is unsuitable. This is the perfect combination for installation in ducts where the air velocity is below 500 fpm or for duct sizes as small as 8 inches in diameter.

Pendant mounted in a standard electrical box within the duct, the twist-in/twist-out head allows easy removal from the base for quick cleaning and maintenance. The detector can be combined with the System Sensor B114LP 120VAC base or the B114LPBT 24VAC/DC base.

Remote testing is accomplished using our RTC100 Remote Test Coil with Low Profile ring accessory that includes the RTS451.

The APA451, Remote Annunciator with Piezo Alarm, can also be connected to provide an audible and visible indication of smoke detector status.



2151 Photoelectric Detector Specifications

Operating Voltage/Alarm current See Base Specifications	Sensitivity 3%±.7% / ft.	Size 1.66 (4.22cm)H 6.1 (155mm)dia. flanged base	Construction Flame retardant thermoplastic	Humidity Range 10 to 93% RH non-condensing
Standby current 85 µA maximum	Weight 3.6 oz. (104 g)		Operating Temperature 32°F to 120°F (0°C to 49°C)	Air Velocity Rating 0 to 3000 fpm

B114LP/B114LPBT Adapter Base Specifications

Loop Type 4-wire	Alarm Contact Type Form A&C + A supply	Alarm Current (mA) 75 mA AC Max.	Relay Contact Ratings Resistive or Inductive (60% power factor) load. Form A: 2.0A at 30 VAC/DC	Form C: 0.6A at 110VDC, 2.0A at 30VDC 1.0A at 125VAC, 2.0A at 30VAC
Current Limit Resistor Yes	Nominal Voltage B114LP: 120 VAC B114LPBT: 24VAC/DC			

B114LP/B114LPBT Junction Box Specifications

Box depth contingent on base and wire size. Refer to National Electric Code or local applicable codes for appropriate recommendations.

Single Gang	3 1/2" Octagon	4" Octagon	4" Square	50mm	60mm	75mm
No	No	Yes	Yes	No	No	No



Engineering Specifications

The air duct smoke detector shall be a System Sensor model 2151 Series Smoke detector UL listed to UL 268A specifically for use in air handling systems when used in conjunction with the B114LP (120 VAC) base or the B114LPBT (24VAC/DC) base. The detector shall operate at air velocities up to 3000 feet per minute. It shall be capable of local testing via magnetic switch or remote testing using the UL listed RTC100 Remote Test Coil accessory with the RTS451 Remote Test Station. It shall be capable of providing duct smoke detector status via the UL listed model APA451 Piezo Annunciator.

B114LP Typical Wiring Diagrams

B114LP Base Terminals

No.	Function
1	Remote Annunciator (+)
2	Not Used
3	Not Used
4	Remote Annunciator (-)
5	Not used
6	N.O. } Supervisory Relay
7	N.O. } Form A Contacts
8	N.O. } Alarm Relay
9	N.O. } Form A
10	C. } Initiation
11	C. } Contacts
12	N.O. } Alarm Relay
13	N.C. } Form C
14	C. } Auxiliary Contacts

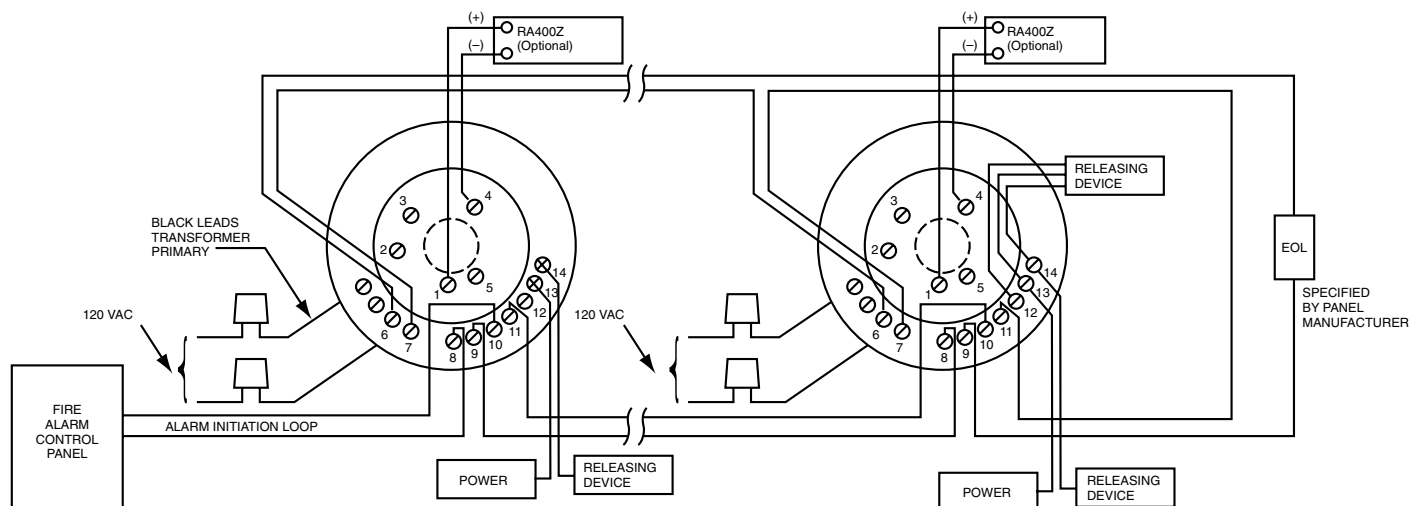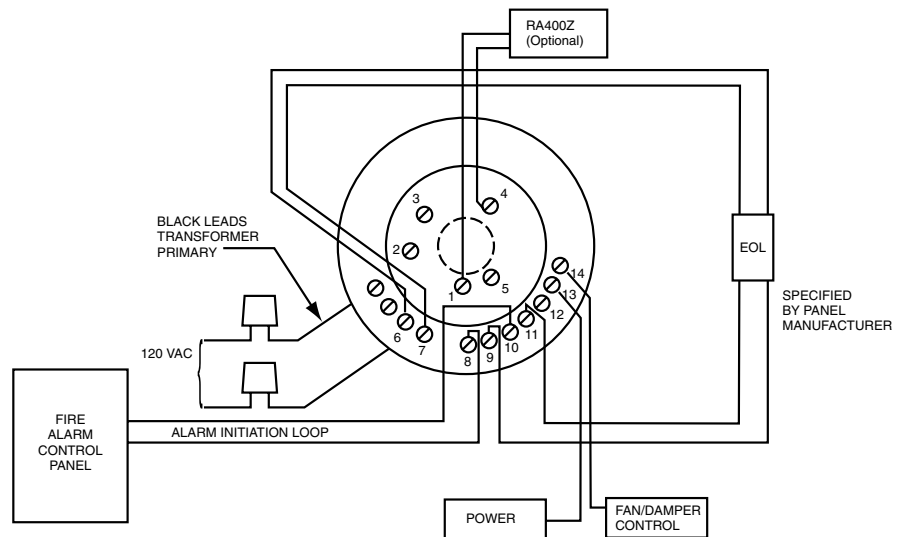


B114LPBT Typical Wiring Diagrams


B114LPBT Base Terminals

No. Function

- 1 Remote Annunciator (+)
- 2 Test Coil (+)
- 3 Not Used
- 4 Remote Annunciator (-)
- 5 RTC (-)
- 6 N.O. } Supervisory Relay
- 7 N.O. } Form A Contacts
- 8 N.O. } Alarm Relay
- 9 N.O. } Form A
- 10 C. } Initiation
- 11 C. } Contacts
- 12 N.O. } Alarm Relay
- 13 N.C. } Form C
- 14 C. } Auxiliary Contacts

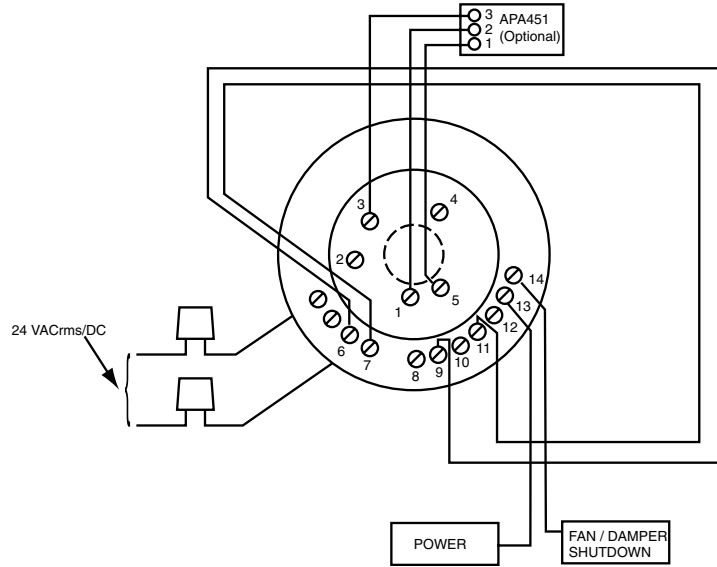


H0269-00

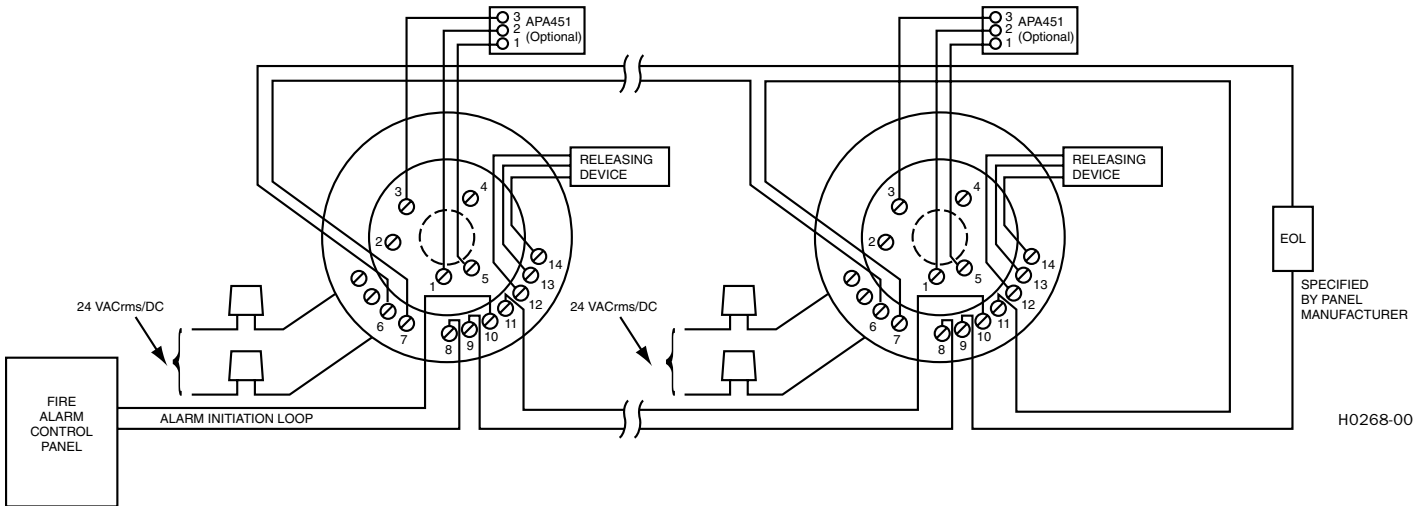


H0268-00


RTC100 Wiring Diagram

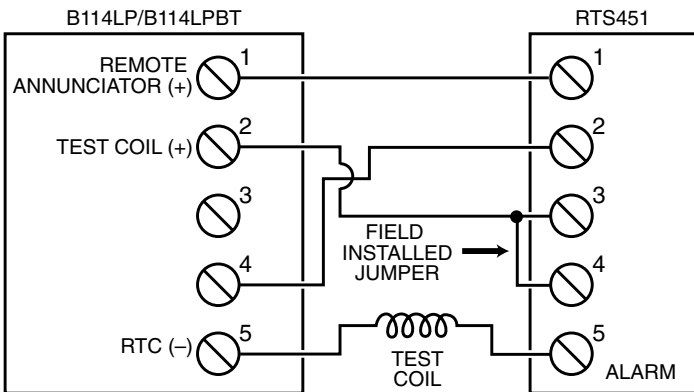


Ring Replacement on B114LP/B114LPBT

NOTE: Installation and wiring of the test coil is required. Please see RTC100 Installation & Maintenance Instructions.

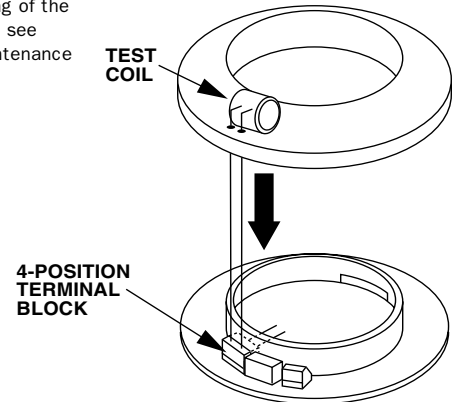


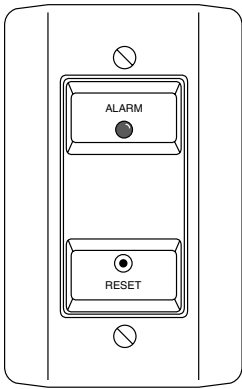


RTS451
Remote Test Station
 (provided with
RTC100 Remote
Test Coil Kit)

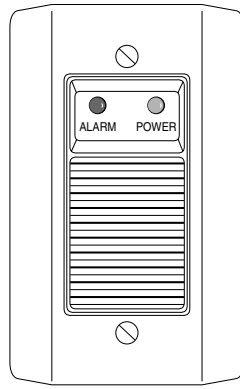

APA451
Piezo Annunciator

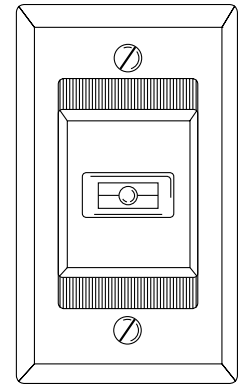

RA400Z
Remote Annunciator

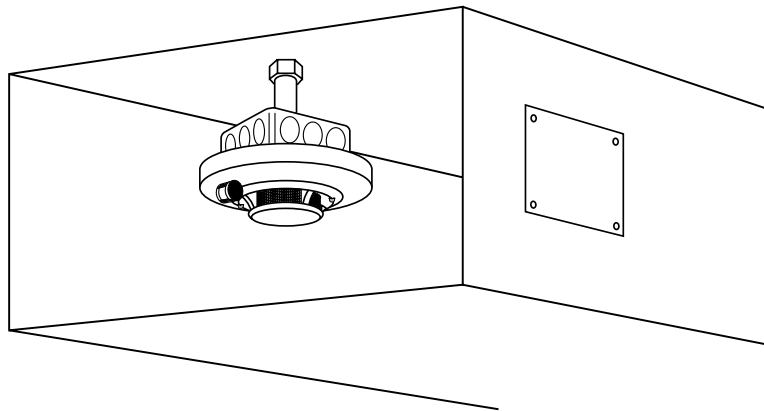

Top Mount in Ventilation Shaft

Ordering Information

Model	Description	Accessories	Description
2151	Low-profile photoelectric plug-in detector (order one of the bases listed below and RTC100)	APA451	Remote annunciator with piezo alarm
B114LP	120VAC detector base	RA400Z	Remote annunciator
B114LPBT	24VAC/DC detector base		
RTC100	Remote test coil kit with low profile ring (Incl. RTS451 remote test station)		

System Sensor Sales and Service

System Sensor Headquarters
 3825 Ohio Avenue
 St. Charles, IL 60174
 Ph: 800/SENSOR2
 Fx: 630/377-6495
 Documents-on-Demand
 800/736-7672 x3
 www.systemsensor.com

System Sensor Canada
 Ph: 905.812.0767
 Fx: 905.812.0771

System Sensor Europe
 Ph: 44.1403.891920
 Fx: 44.1403.891921

System Sensor in China
 Ph: 86.29.524.6253
 Fx: 86.29.524.6259

System Sensor in Singapore
 Ph: 65.6273.2230
 Fx: 65.6273.2610

System Sensor – Far East
 Ph: 85.22.191.9003
 Fx: 85.22.736.6580

System Sensor – Australia
 Ph: 613.54.281.142
 Fx: 613.54.281.172

System Sensor – India
 Ph: 91.124.237.1770 x.2700
 Fx: 91.124.237.3118